

MEDIUM VOLTAGE "R" RATED FUSE


CAT. NO. A051B1DARO-(2R-12R)
A051B2DARO-(18R-24R)

2R-24R 5.5KV
PEAK LET THRU CURRENT DATA



Newburyport, MA 01950

102652

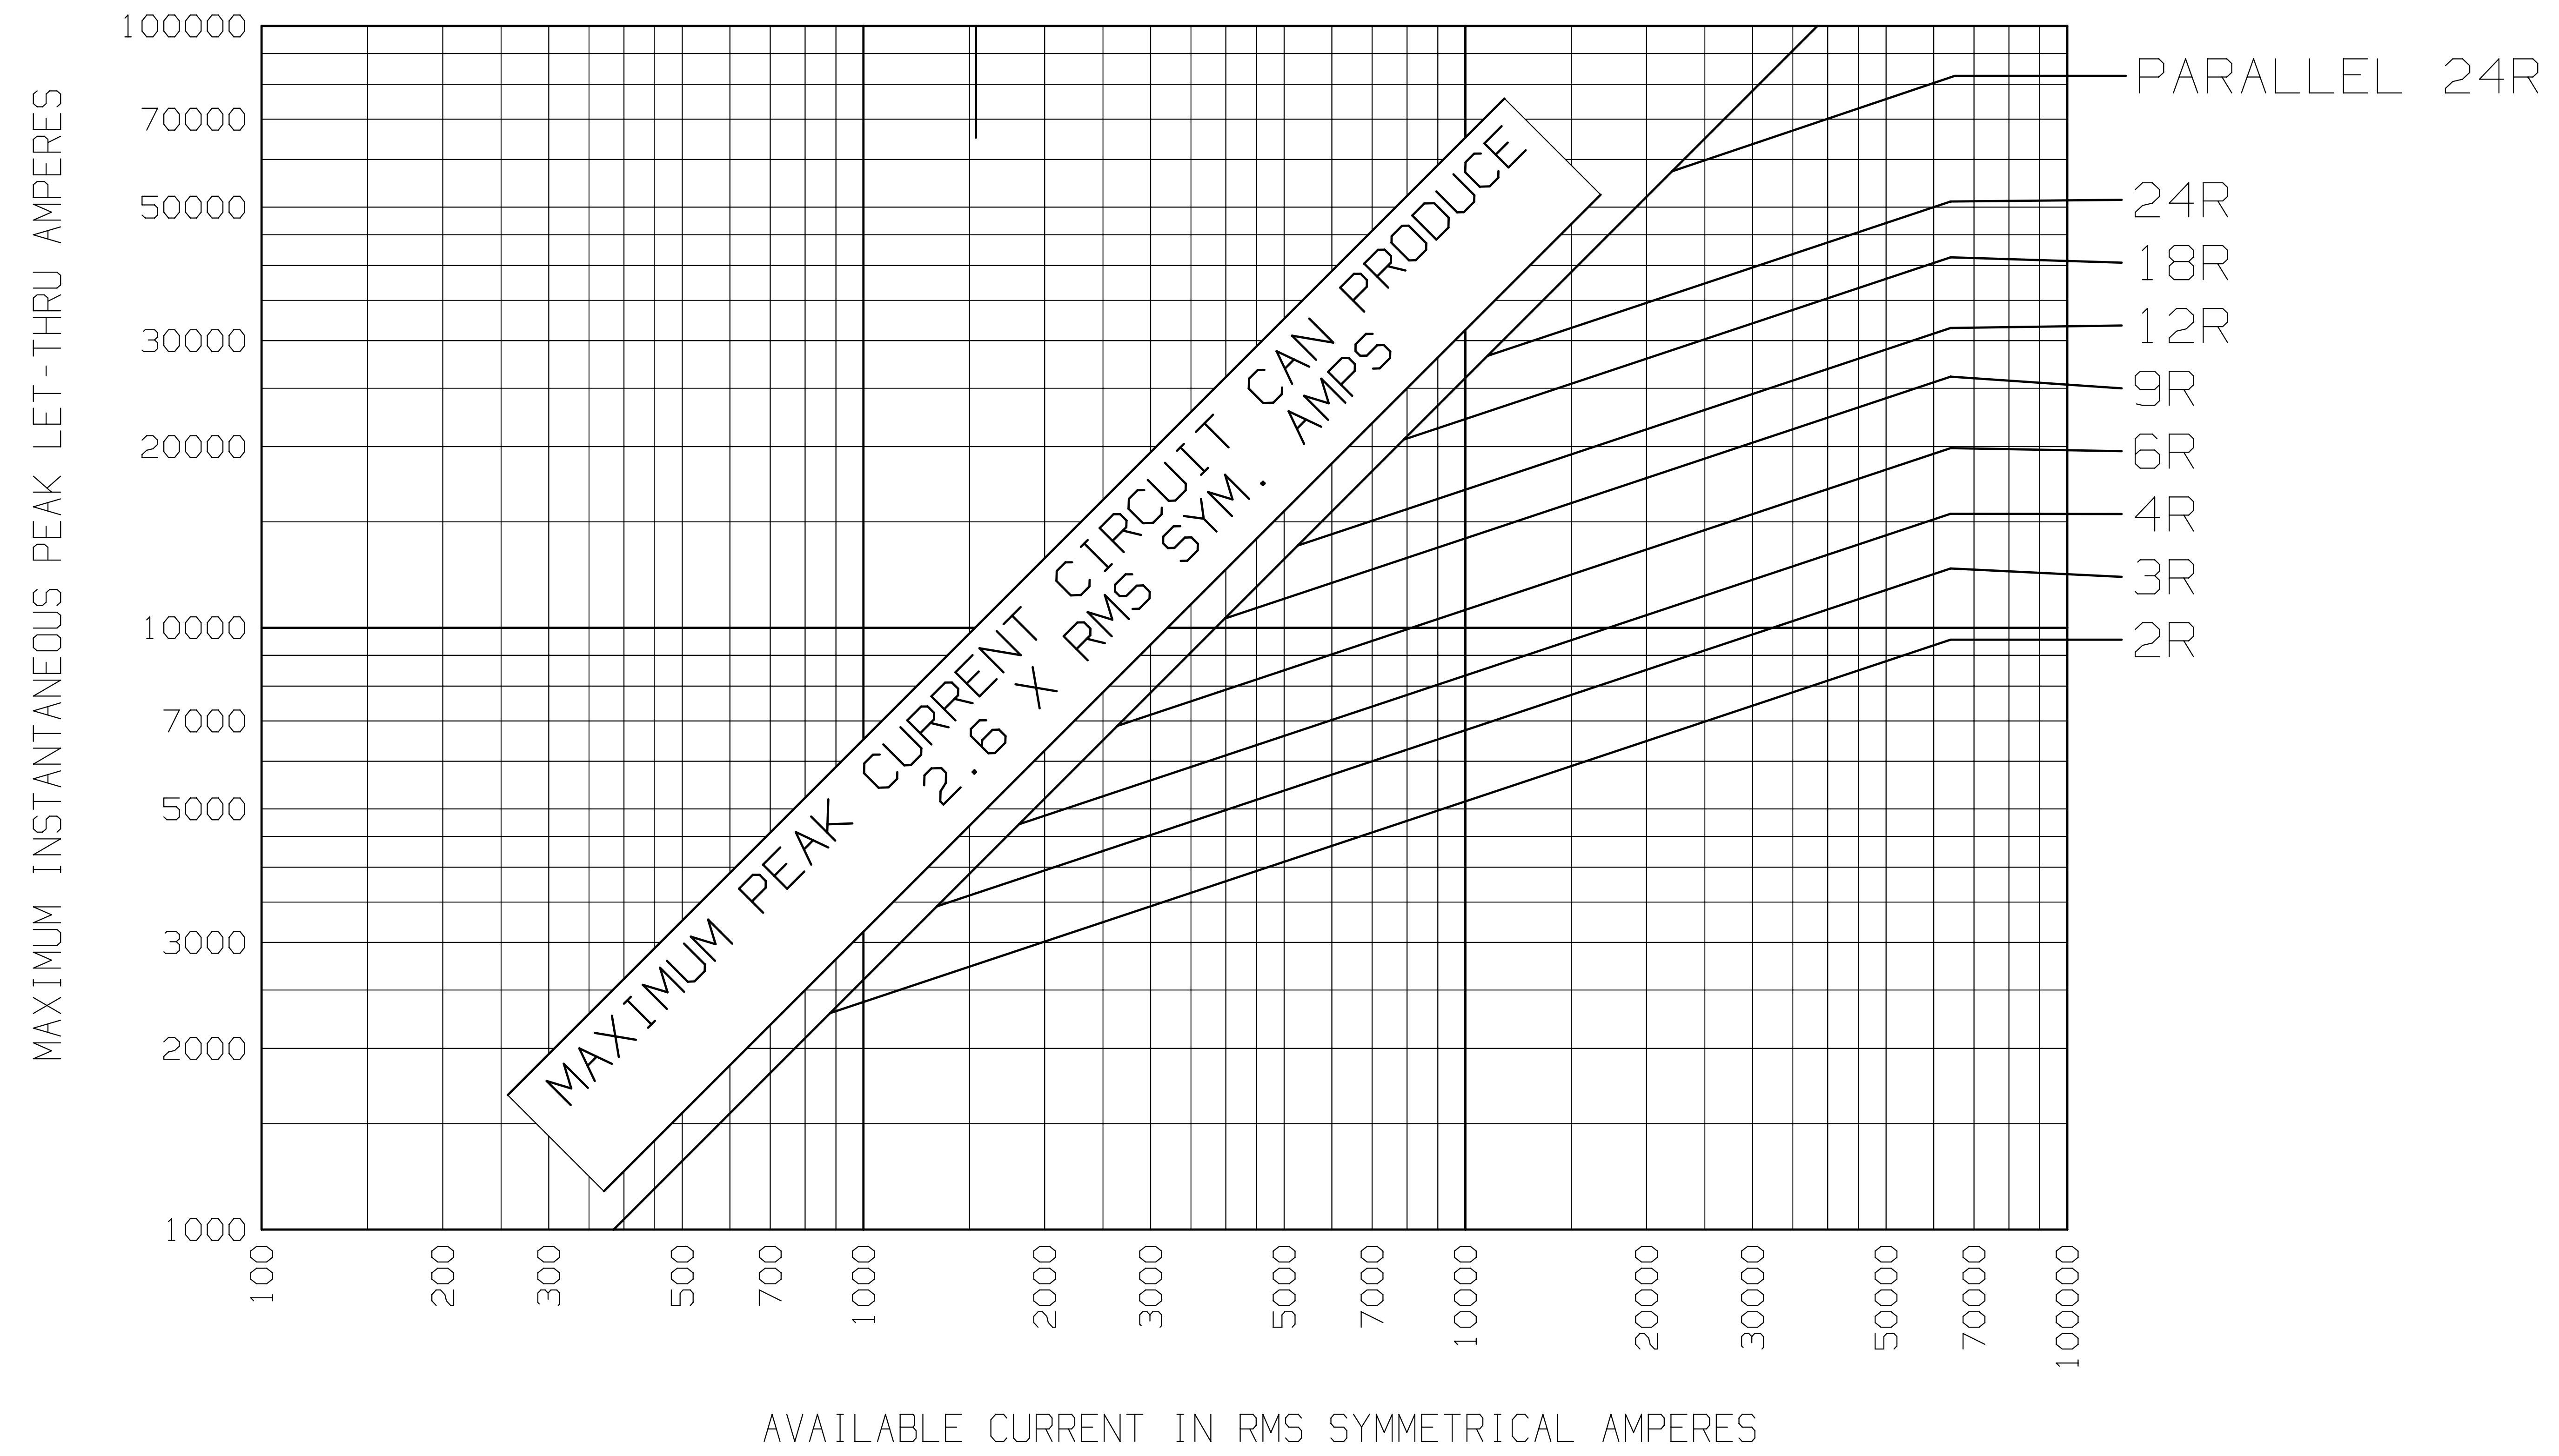

CONTROL NO. : 731
REV. : B
FOLDER NO. : 5B
2/10/05