


FORM 600 AMP-TRAP FUSE  
 PEAK LET THRU CURRENT DATA  
 70-2000 AMPS  
 CAT. NO.  
 A2Y(70-600) TYPE 3, 4 & 5 250VAC/500VDC  
 A5Y(70-600) TYPE 3 500VAC/500VDC  
 A6Y(70-2000) TYPE 3, 3G, 4, 5, 21, & 58 600VAC/500VDC  
 FERRAZ SHAWMUT  
 NEWBURYPORT, MA 01950  
 06524

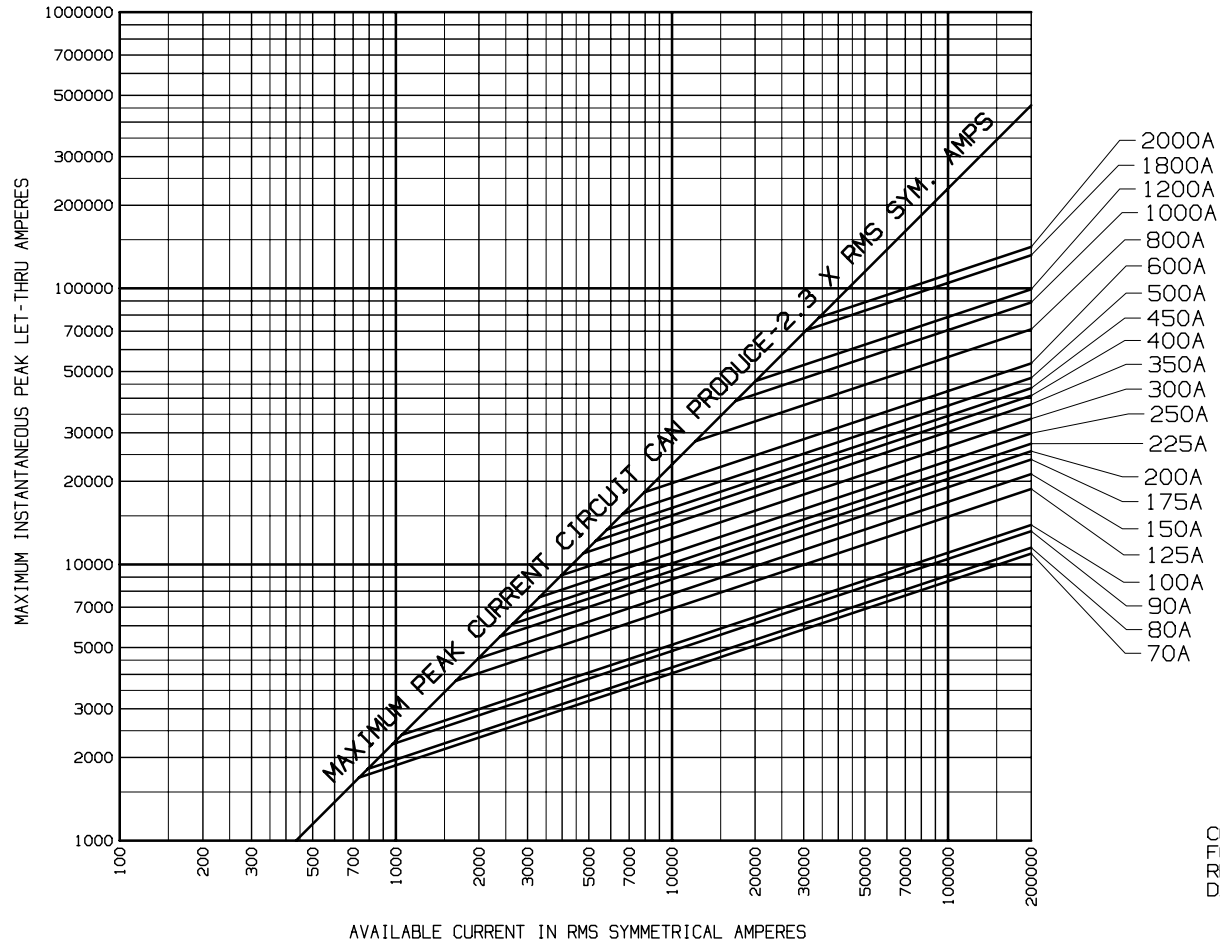

CONTROL NO.: 1054  
 FOLDER NO.: 40A  
 REVISION: C  
 DATE: 3-6-07