


MEDIUM VOLTAGE AMP-TRAP FUSE
 TOTAL CLEARING TIME CURRENT DATA
 BOLT IN 5.5KV
 CAT. NO. AC55B3D0R0-(750E-900E)
 AC55B3DBR0-(750E-900E)
 FERRAZ SHAWMUT
 NEWBURYPORT, MA 01950

24447

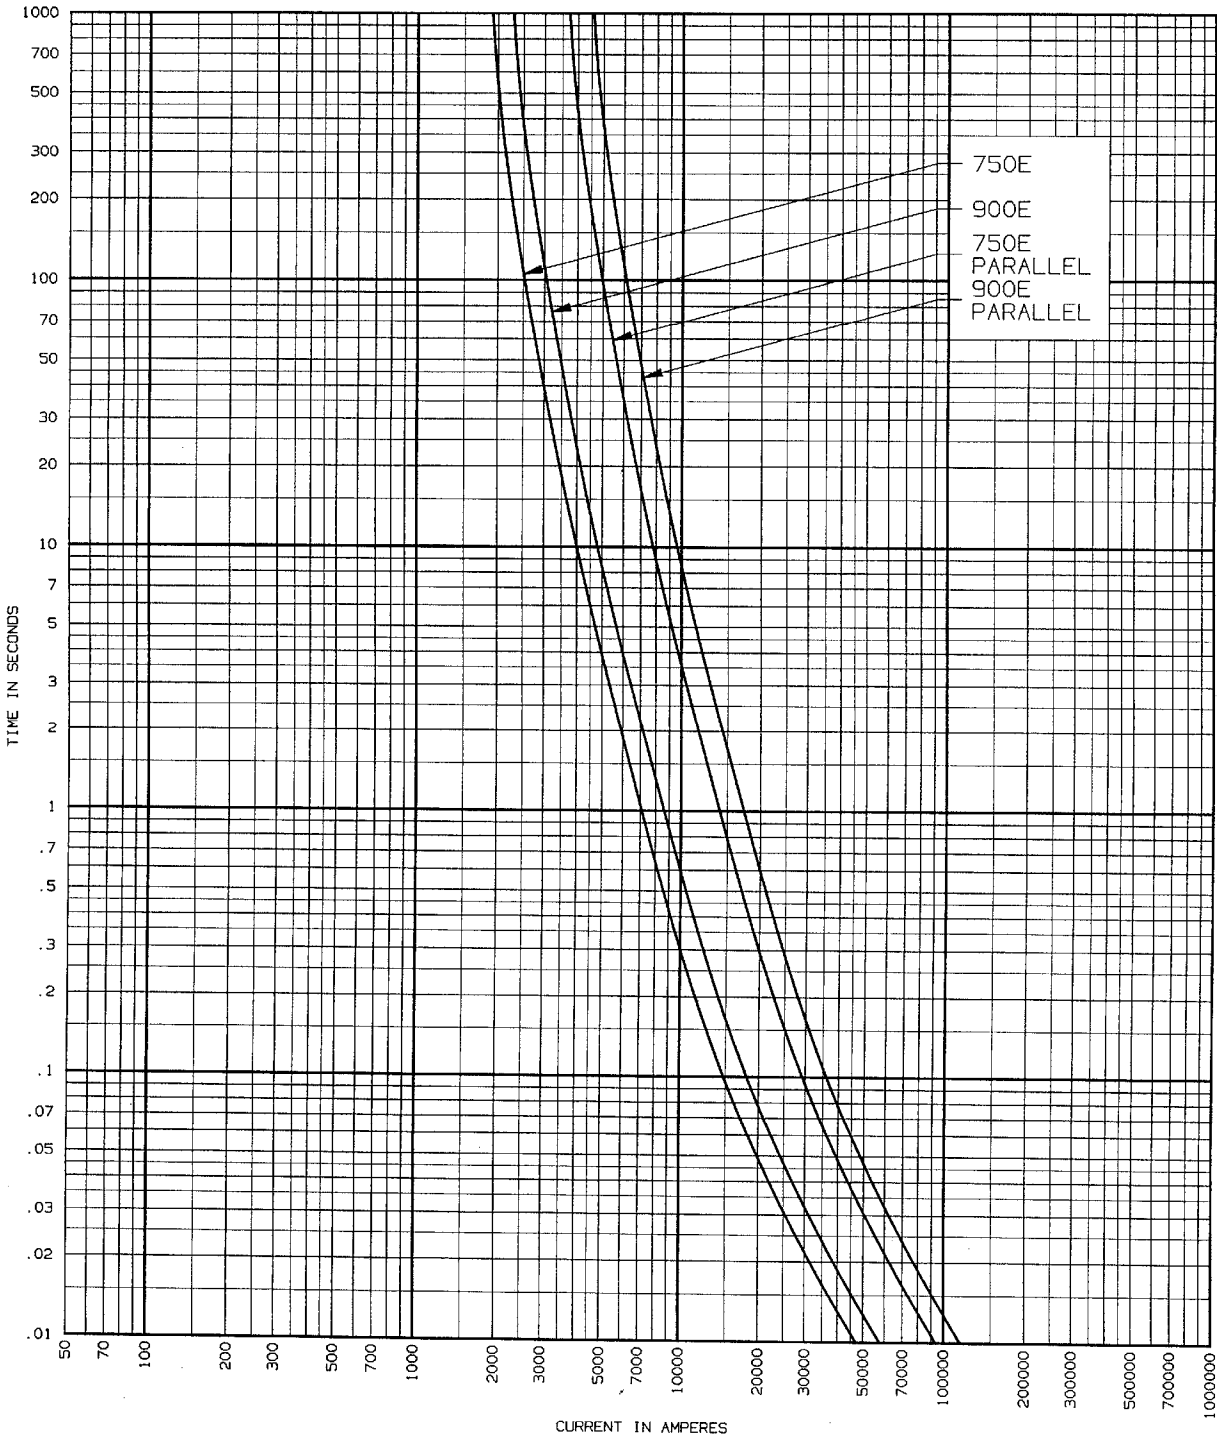

CONTROL NO: 729
 FOLDER NO: 5B
 REV: A
 2/10/05