


MEDIUM VOLTAGE AMP-TRAP FUSE
 MINIMUM MELTING TIME CURRENT DATA
 CS-3 5.5KV
 CAT. NO. A055F1CORO-(5E-65E)
 MERSEN USA NEWBURYPORT-MA, LLC
 NEWBURYPORT, MA 01950

24436

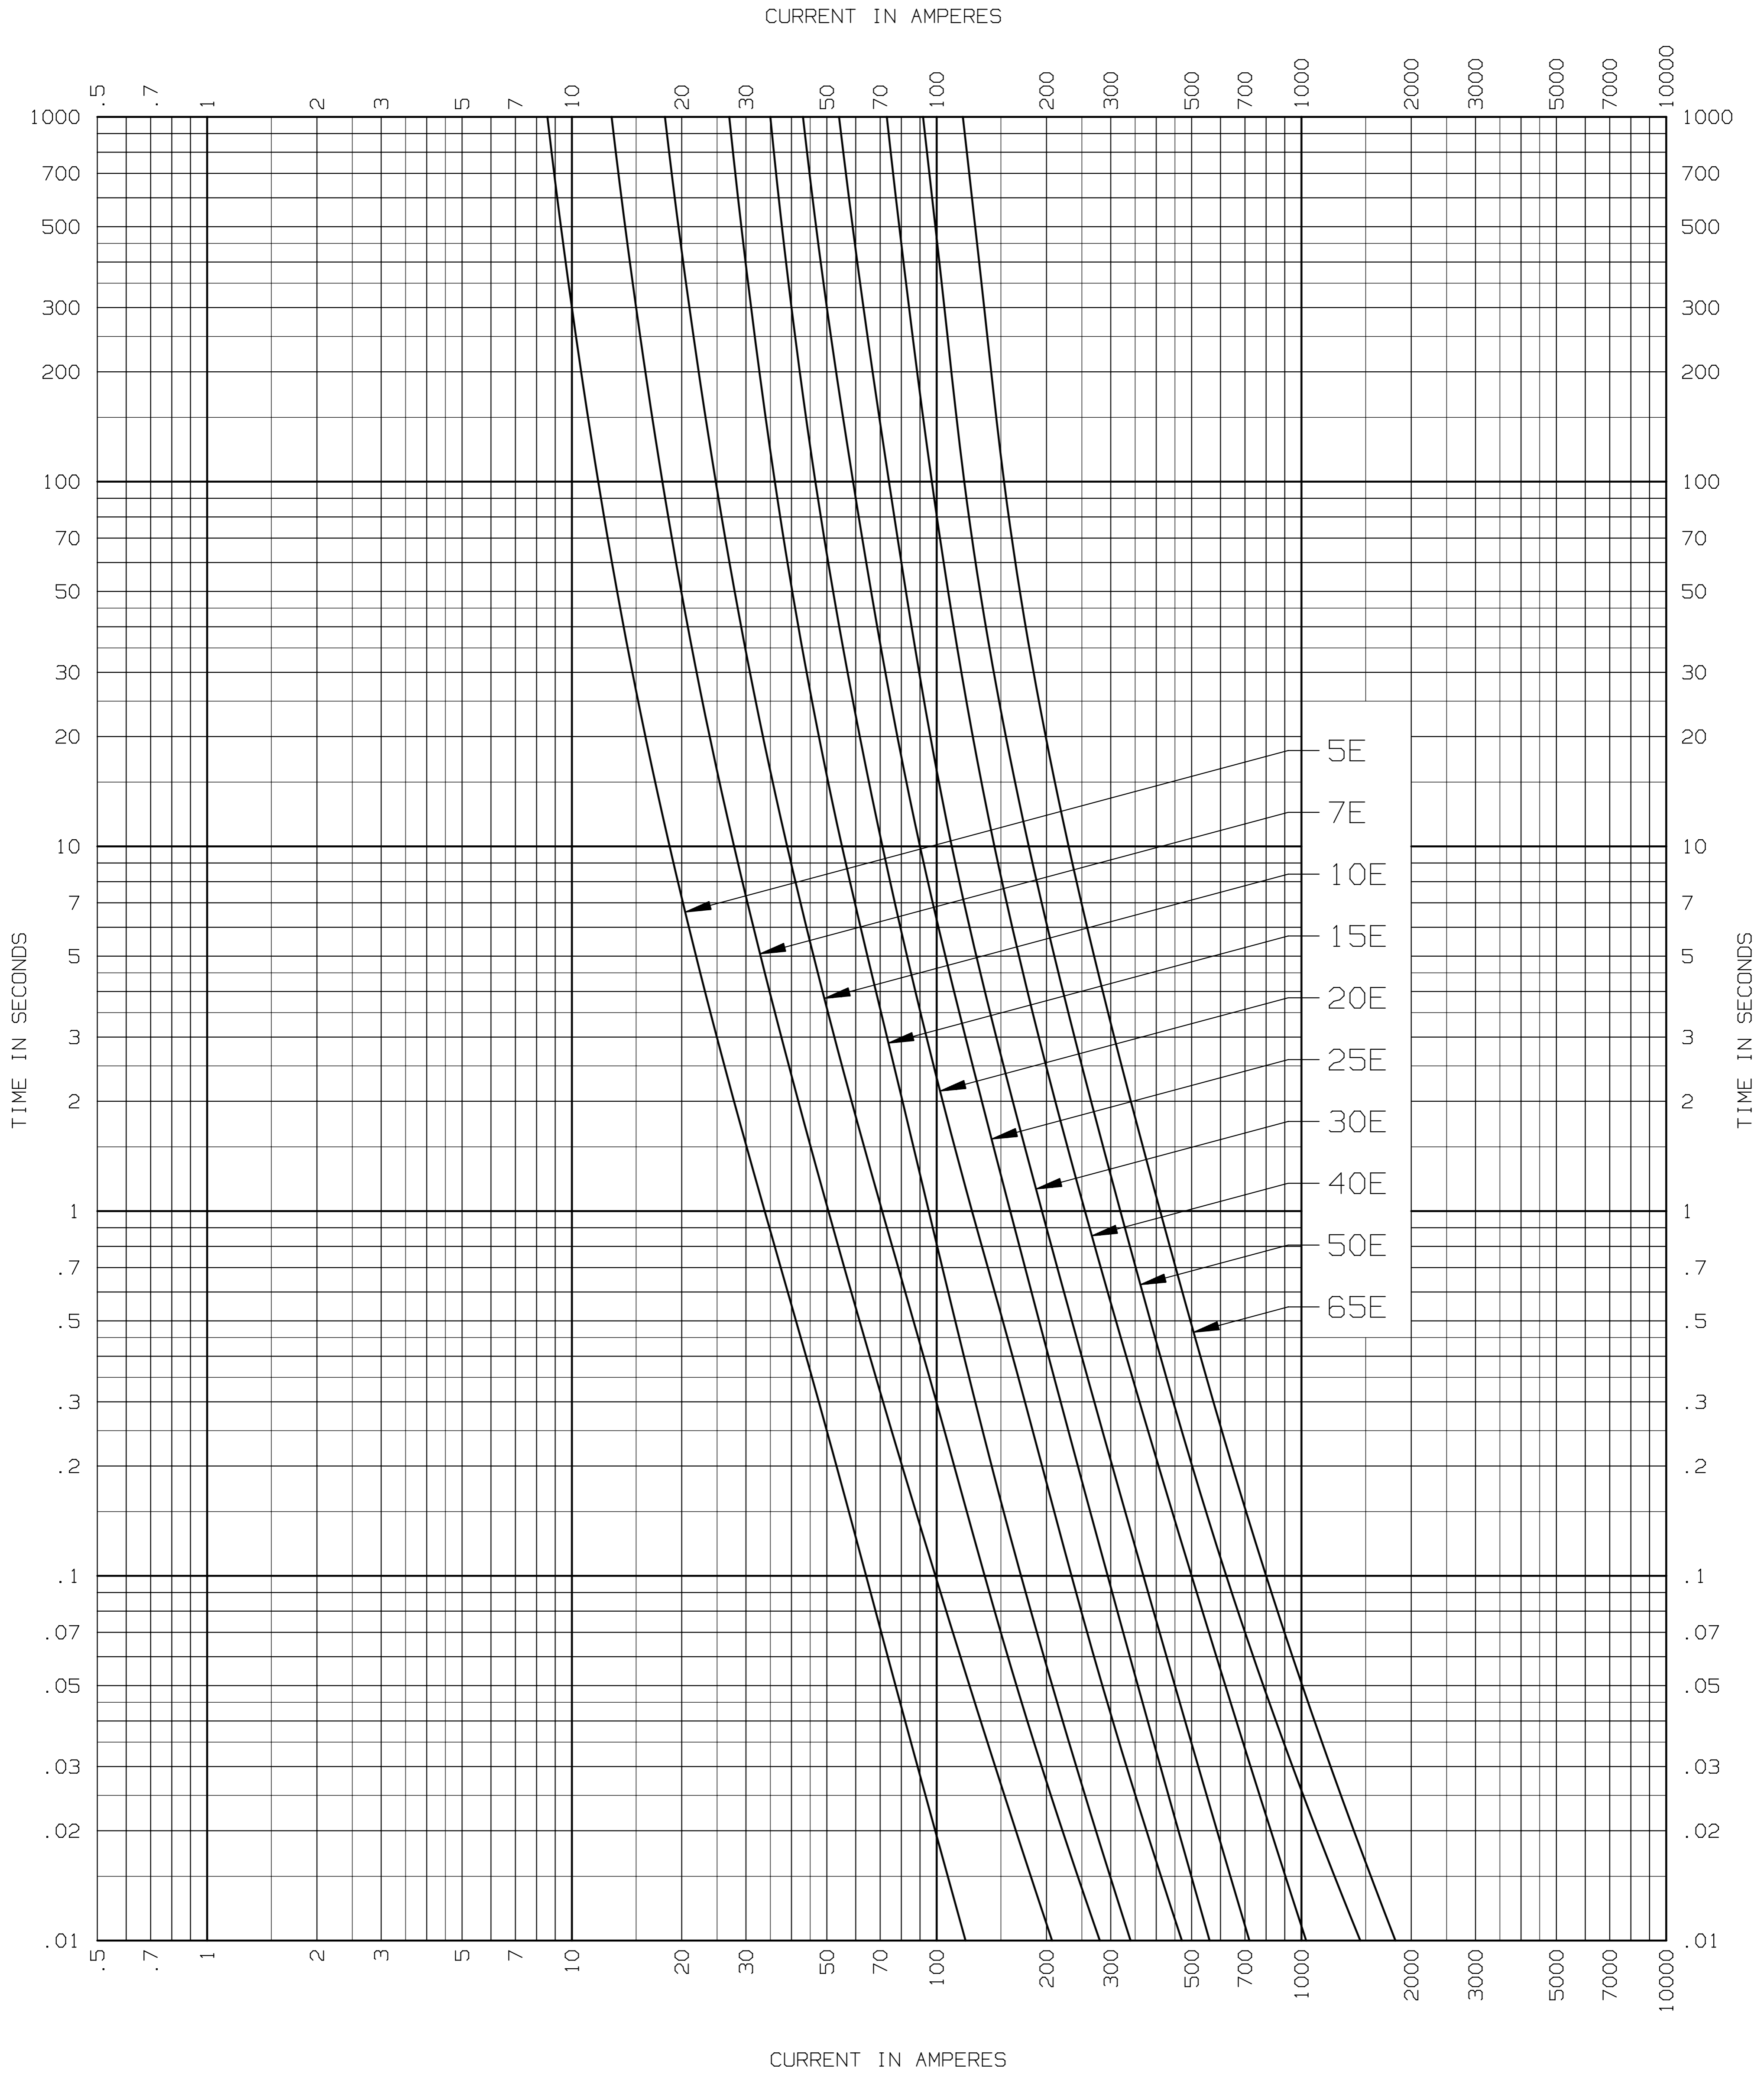

CONTROL NO.: 1340
 REVISION: -
 FOLDER NO.: 5B
 DATE: 2-8-11