

MEDIUM VOLTAGE R-RATED AMP-TRAP FUSE


CAT. No. A240R(1-36)R

CS-3 2.6kV MAX.

MINIMUM MELTING TIME CURRENT CURVE

MERSEN  
NEWBURYPORT, MA 01950

720507

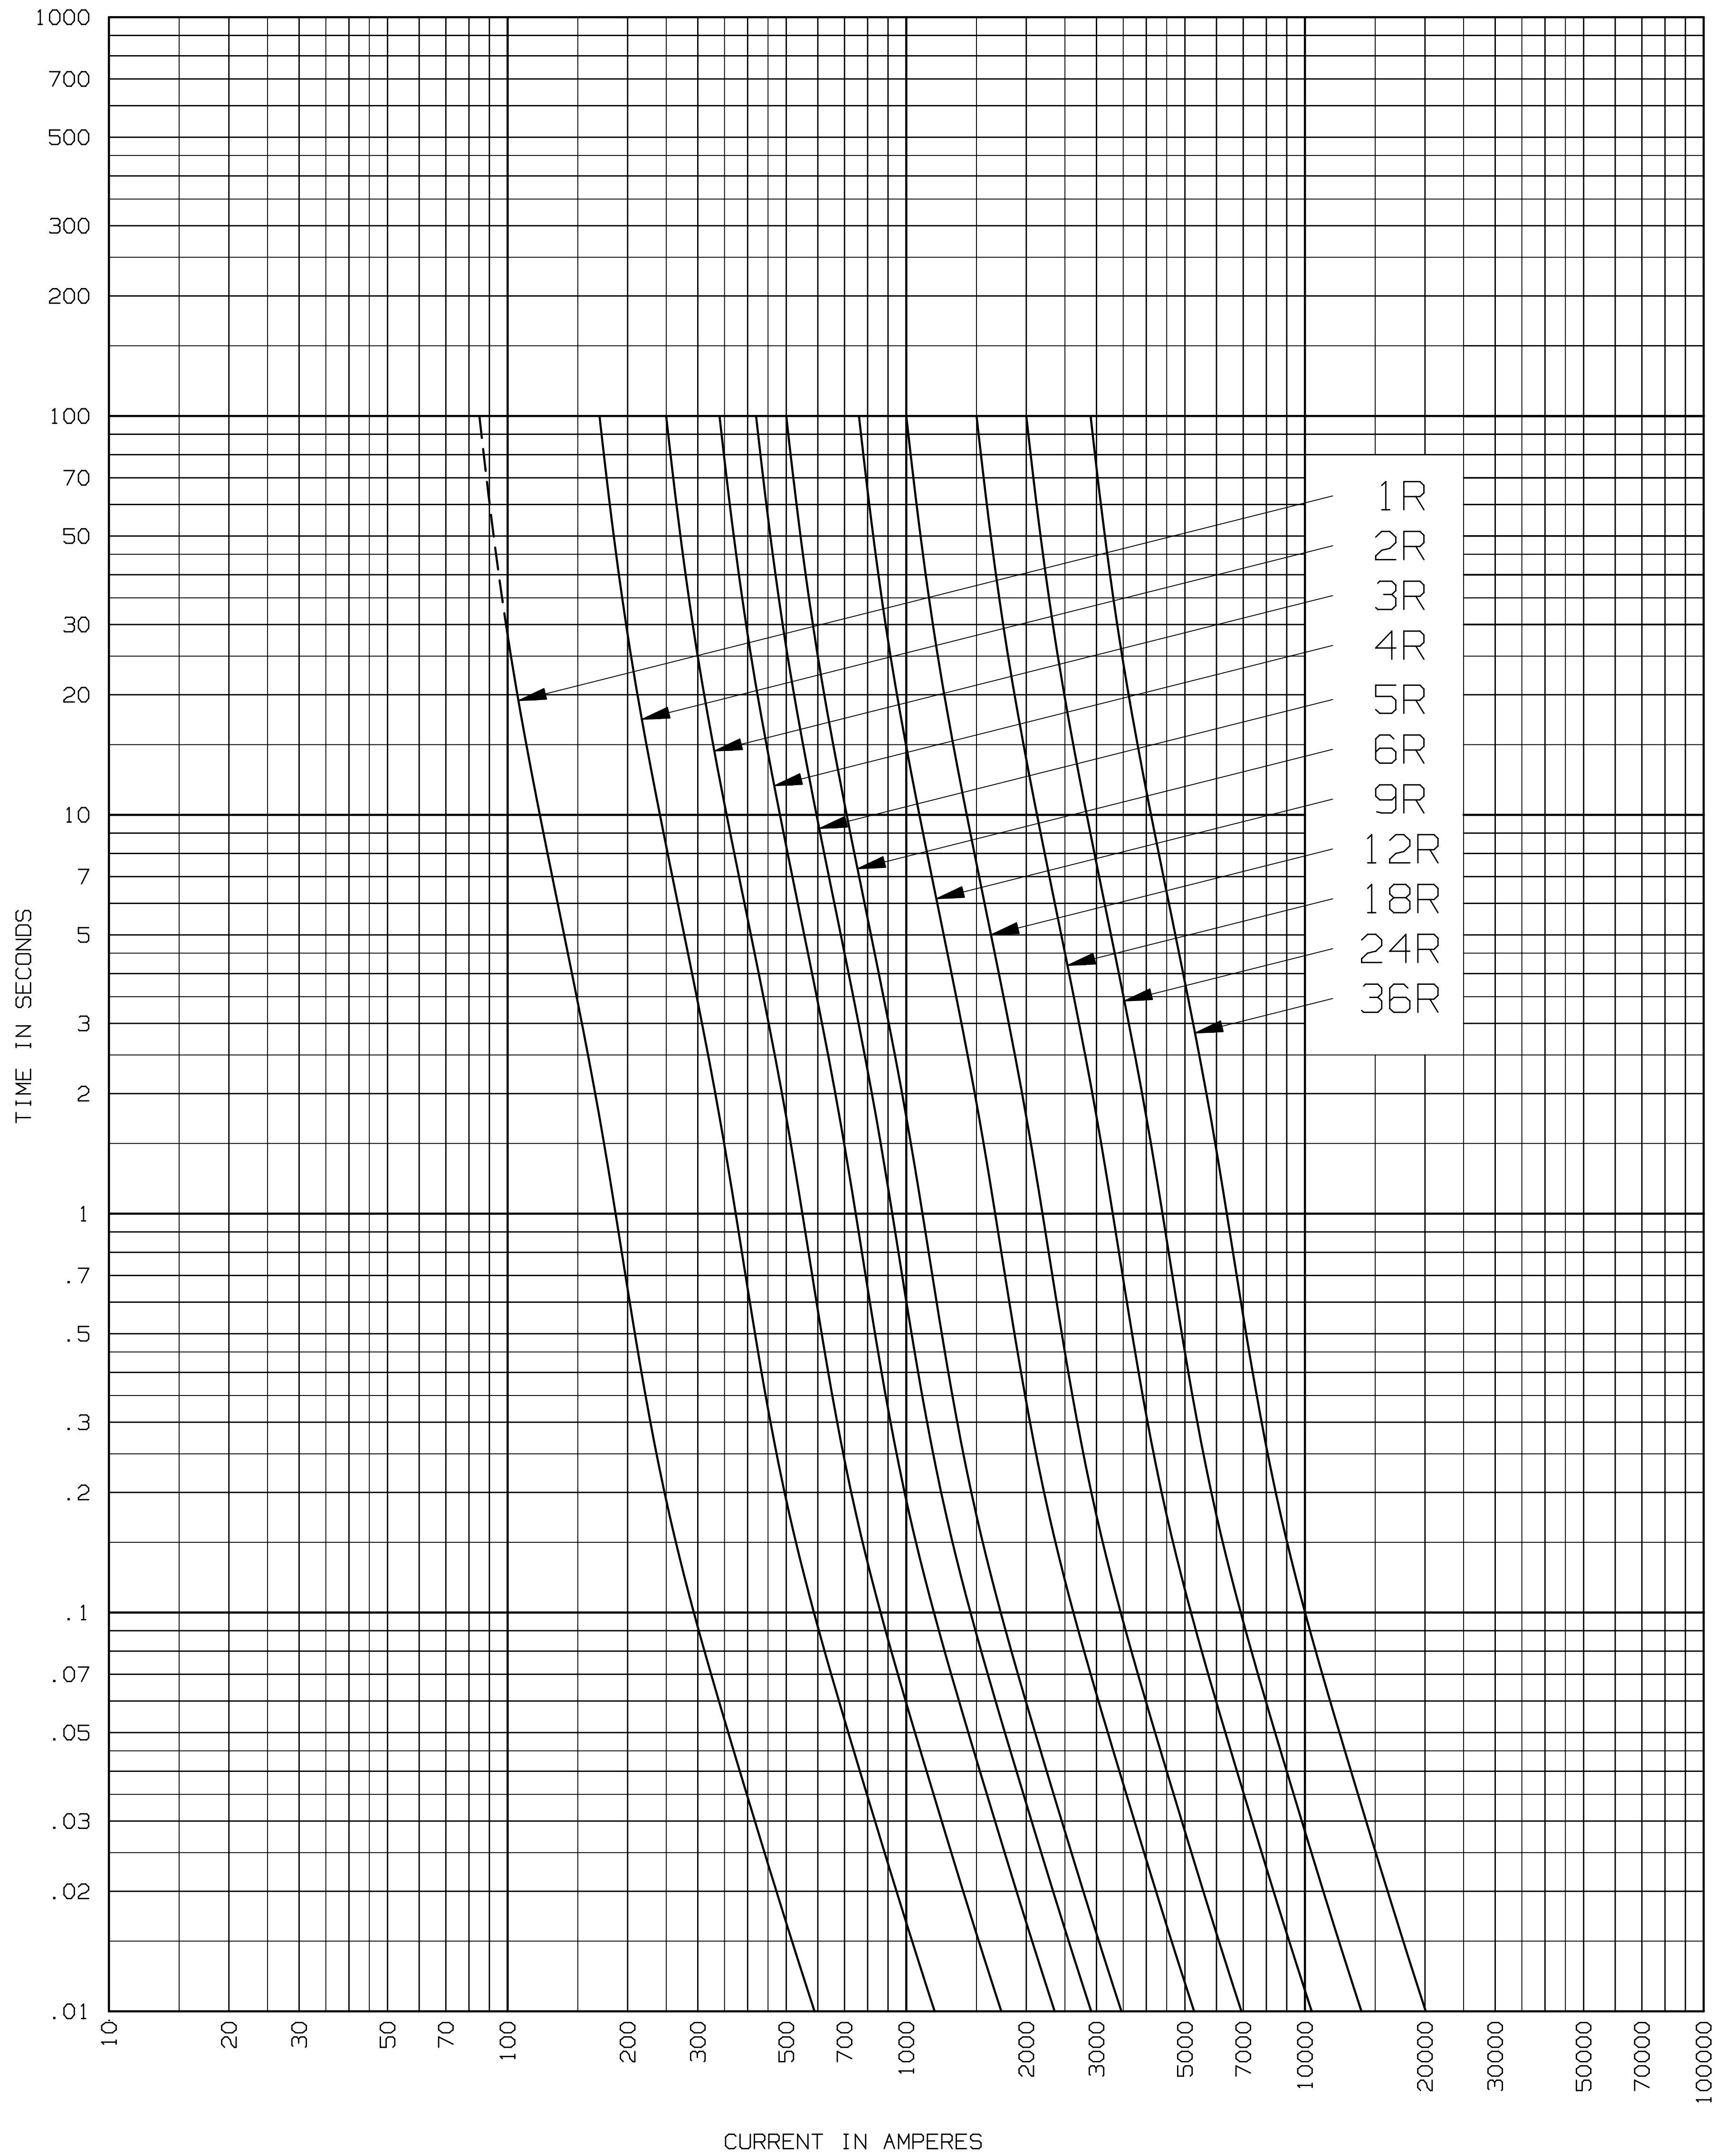

CONTROL NO: 1215

FOLDER NO: 14B

REV.: C

DATE: 7-14-10