

MEDIUM VOLTAGE R-RATED AMP-TRAP FUSE


CAT. No. A240R(1-36)R

CS-3 2.6kV MAX.

TOTAL CLEARING TIME CURRENT CURVE

MERSEN
NEWBURYPORT, MA 01950

720590

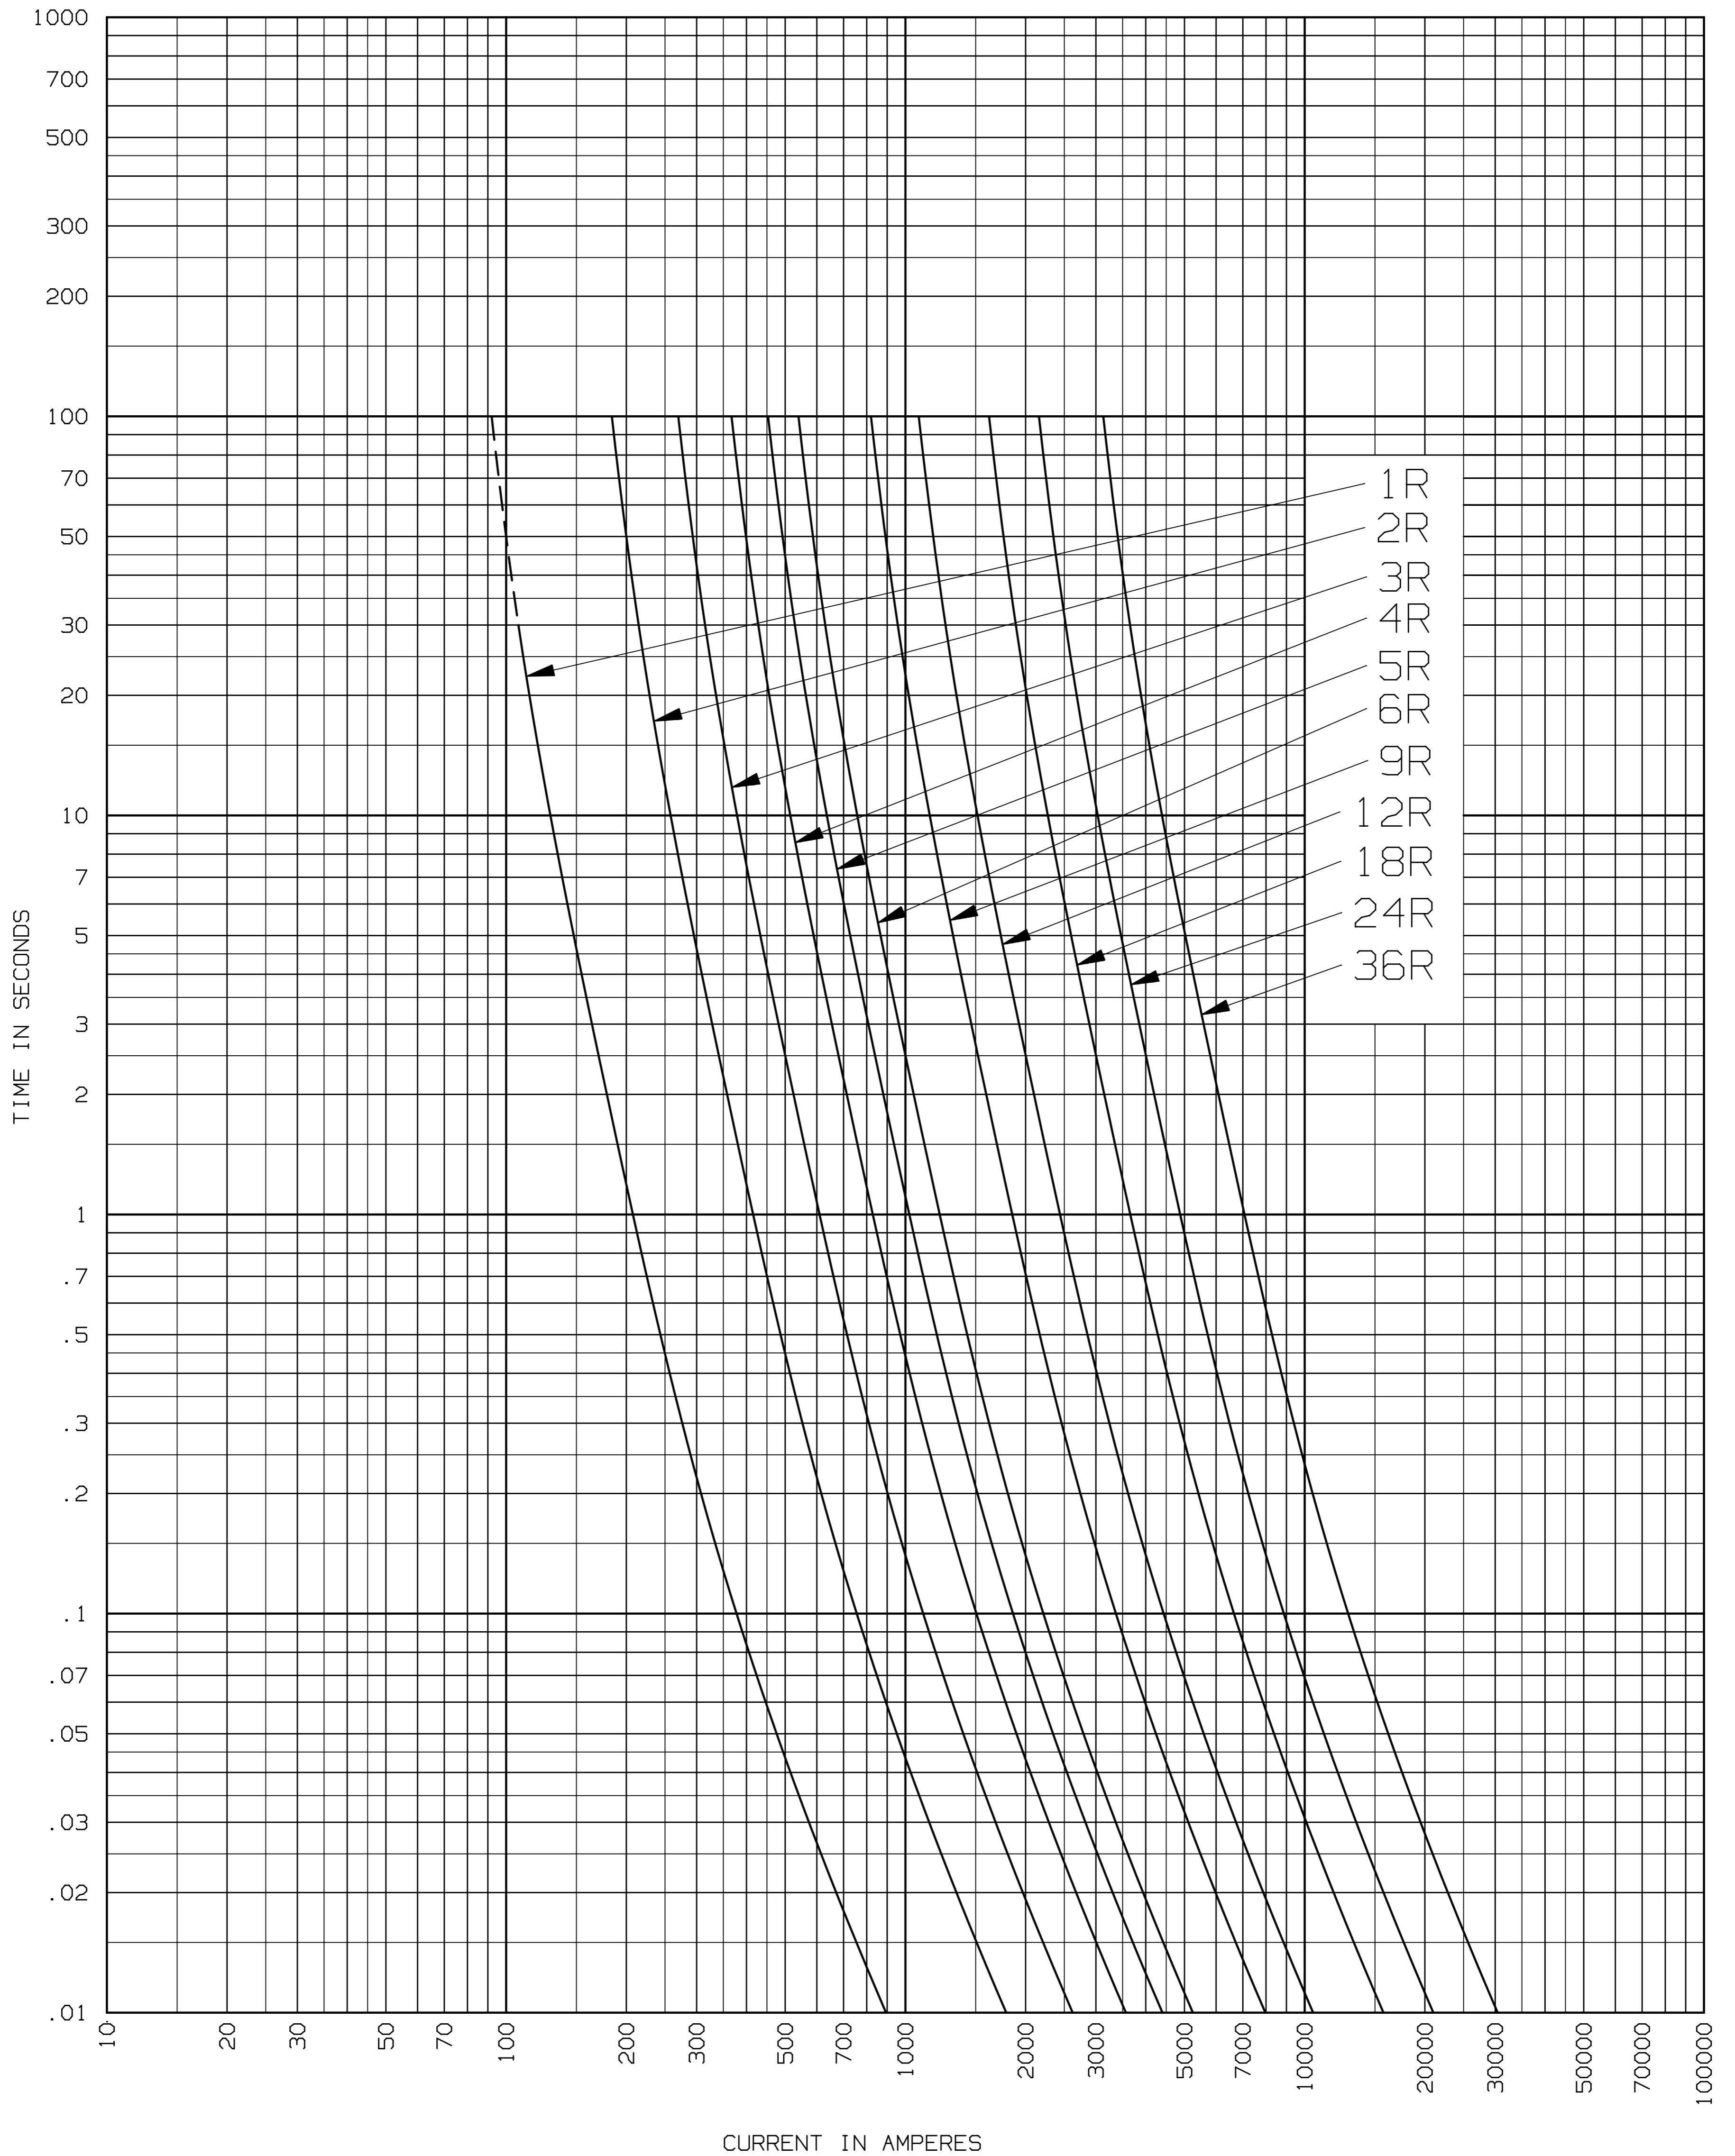

CONTROL NO: 1215

FOLDER NO: 14B

REV.: B

DATE: 7-14-10