


CABLE PROTECTOR AMP-TRAP FUSE  
**CL-14**  
A083C2D0R0-200E  
200E 8.3KV  
**MINIMUM MELTING TIME CURRENT CURVE**

FERRAZ SHAWMUT  
NEWBURYPORT, MA 01950

720471

CURRENT IN AMPERES X10

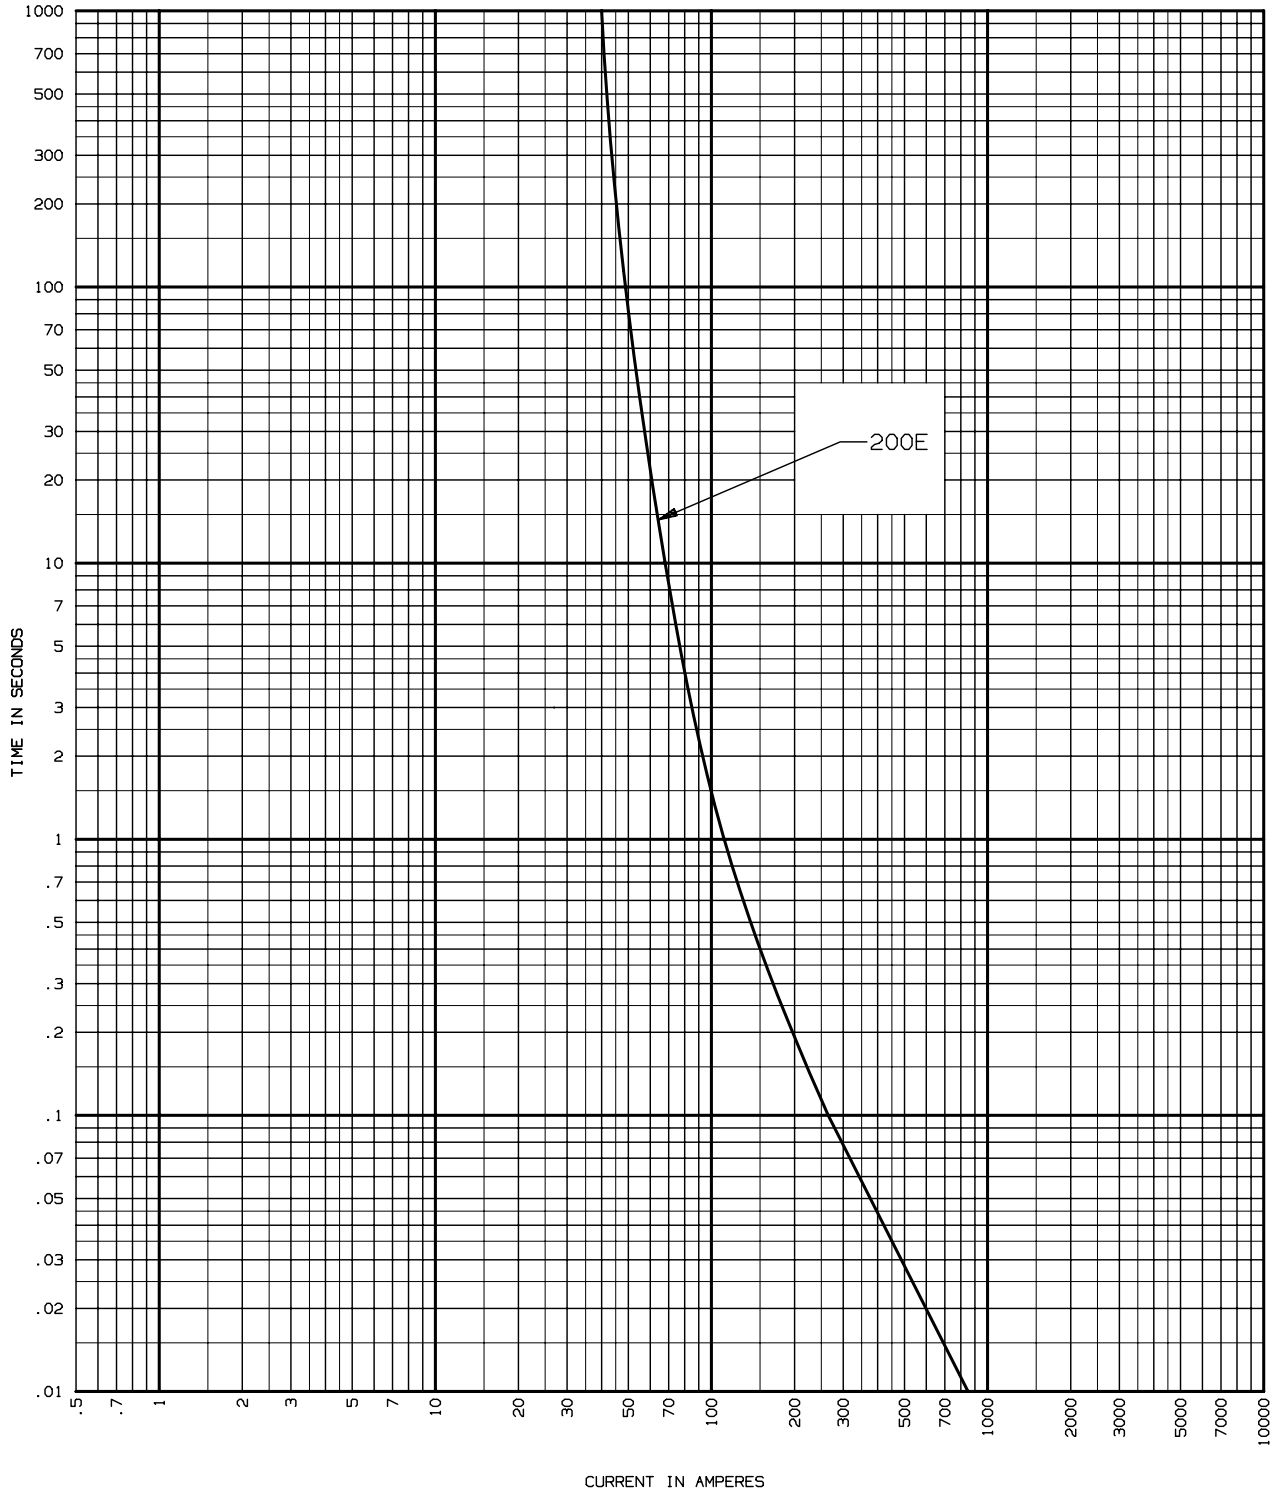

CONTROL No: 1190  
FOLDER NO.: 14A  
REV. A  
2-13-08